

Analysis Of Effects of Conductor Transposition on the 132kv Alaoji - Port Harcourt Transmission Line

AWUJE THANKGOD¹, D.C. IDONIBOYEGBU², S.L. BRAIDE³

¹ Department of Electrical Electronics Engineering, Rivers State University, Port Harcourt, Nigeria.

² Professor, Department of Electrical Electronics Engineering, Rivers State University Port Harcourt, Nigeria.

³ Department of Electrical Electronics Engineering, Rivers State University Port Harcourt, Nigeria.

Abstract- This study analysed the effects of conductor transposition on the 132kv Alaoji-Port Harcourt transmission lines. This study was motivated on the grounds that the inductance and capacitance of conductors will not be equal if they are not transposed at regular intervals. When parallel conductors, such as power lines, are run in parallel with transmission lines, excessive voltages can be induced in the lines. As a result, acoustic shock or noise may occur. This unfavourable phenomenon is considerably reduced by transposition. Also, the Spacing between conductors in a transmission line is not same in practice which also causes limitation in the transmission of energy. However, conductors are not usually transposed in transmission lines in practice. The switching stations and substations are where the transposition takes place. In Nigeria, One of the major challenges affecting the transmission line system is the line losses and continual vandalism of the 132KV transmission lines throughout the country's various areas the article gives an examination of a 132kv transmission line with and without transposition using Matlab and the EMTP (Electromagnetic Transients Program), particularly Bergeron's basic constant parameter model. Findings from this analysis shows that the unbalance obtained in this case without transposition is 1.39%. The results with transposition differ very little, but those without transposition have a deviation of 1.39%; which exceeds the maximum allowable unbalance value. The findings support the continuation of research in this direction, and they can also be used to the challenge of determining the allowed imbalance level in longer lines. The study suggests that in order to obtain a favorable outcome when balancing power flows via phases and circuits of multi-conductor lines, additional techniques for conductor transposition should be investigated in

order to reach a better degree of line-wide equilibrium.

Indexed Terms- Conductors, Line, Matlab, Transposition, Transmission

I. INTRODUCTION

1.1 Background of Study

The high speed of electromagnetic waves engendering is a benefit of power as a valuable energy structure since it gives the capacity to communicate power at huge spans and an adaptable appropriation. The transmission and conveyance of electric power is given by electric lines of various useful acknowledgment. In this unique situation, electrical cables are a significant practical part of contemporary power frameworks (Cedeno et al, 2017). The helpful straight forwardness of the electrical cables doesn't mean the effortlessness of the actual cycles in these framework components of the power frameworks.

The mass transportation of electrical energy from a producing site, such as a power plant, to an electrical substation is known as electric power transmission. A transmission organization is a collection of interconnected lines that help with this development (Grainger, 2003). As indicated by existing idea the interpretation of transmission line stages is planned for decreasing the unbalance of flow and voltage in typical activity method of electric framework and for restricting the obstructive impact of transmission lines to low-recurrence transmission channel. The principal move of power a ways off of 1km was shown by Fontaine in 1873, who thought about that such exchanges are conceivable just for little limits and for brief distances. The hypothetical viewpoints in regards

to the transmission of power at significant distances were created by Lachinov and Deprez and the final remaining one out of 1882 gave the exchange of power by link a good way off of 57 km among Munich and Miesbach with the yield of 22% and in 1883 the productivity came to 62% (Puumeto et al, 2017). How about we notice, that the worth of the yield isn't the main list that can impact the monetary seriousness of the power transmission frameworks. The invention of the three-stage rotating flow (1888) and the rise in voltages paved the way for the expansion of electrical organizations, which were represented by processes typical of long lines. In 1891, Dolivo-Dobrovolsky and engineer Brown organized a 170 kilometre power exchange from Laufen on Neckar to the Frankfurt Electrical Engineering Exposition, with a 75 percent yield (Colome, 2003). The unbalance in the three-stage AC framework was caused by the extension of the length of the electrical wires and the asymmetrical area of the stage conveyors. Adjusting the boundaries of the periods of the great voltage lines is finished by a few strategies: changing the common area and the distances of the stage conductors, of the separation from the outer layer of the dirt and so on To streamline the stage situating it is prescribed to utilize the stage evening out standard, the adjustment of the distance among stage and conductor conductors, the utilization of new conductors with great mechanical qualities, interpretation of stage conductors. As an answer for guarantee the evenness in the long queues, it was proposed to render the stage conductors for lines with flat stage designations, the length of the interpretation cycle should not exceed 24 kilometres, and for triangular assignments, it should not exceed 48 kilometres.

The discrepancy between the boundaries of discrete line stages appears to be so minor at such interpretation cycle lengths that the unbalance of current and voltage caused by it is quite insignificant. As a result, normal line boundaries are considered during electrical framework estimates. The display of real links is hampered by the availability of materials. Metals' poor conductivity adds a series of unfortunate terms to the trademark terms. Dielectrics, on the other hand, have finite resistivity, which introduces a shunt misfortune term. The more important consideration for true connections is that boundaries shift over time. The transmission line framework is crucial because it seeks

to deliver power from a source of creation to end users. Despite the importance of guaranteeing primary security of a transmission tower-line system during its administration life, a high percentage of failures have been attributed to environmental conditions in the past (Dempsey and White, 1996).

Downbursts and High Intensity Wind (HIW) events are examples of this twisters which accentuate the importance of exact plan wind loads. Examinations of disappointment records of transmission towers in a few nations showed that downbursts are liable for over 80% of the disappointment of transmission line towers around the world (Dempsey and White, 1996).

A new trial study by (Elawady et al, 2018) has shown that terrain openings and link weight impact downburst location and loads that lead to the most extreme conductor response. Expanding the cross-segment of the electrical conveyor is an expense effective way of further developing the energy effectiveness of the electrical association. For sure, global specialized guidelines for link estimating don't consider energy productivity however just wellbeing and voltage drop. The conductor get segment that is financially ideal over the life-pattern of the framework is subsequently for the most part generously bigger than the specialized norm. The energy investment funds that follow from a financially ideal conductor cross segment additionally lead to a decrease in the ozone depleting substance (GHG) emanations throughout the existence season of the framework, making such enhancement a profoundly savvy environmental change moderation measure.



Figure 1.1: A typical 132kv Transmission line steel Tubular pole

Transposition of conductors is the swapping of conductor positions on a transmission line on a regular basis to reduce crosstalk and, in any event, to improve transmission (Prof. D. C. Idoniboyeobu, Lecture manual on power tech). Individual conduits are traded at arches, such as interpretation towers or utility shafts, for overhead electrical cables or open pair correspondence lines. The shared impact of electrical conveyors is decreased by rendering. Rendering likewise balances their impedance comparative with the ground, accordingly keeping away from uneven burdens in three-stage electric power frameworks. Rendering is a successful measure for the decrease of inductively connected ordinary mode impedances. A rendering plan is an example by which the conductors of overhead electrical cables are translated at rendering structures. To guarantee adjusted capacitance of a three-stage line, every one of the three conductors should hang once at each position of the overhead line. At an interpretation tower, the conductors change their overall spots in the line. A translating construction might be a standard design with uncommon cross arms or perhaps an impasse structure. The translating is vital as there is capacitance between conductors, just as among conductors and ground. This is ordinarily not even

across stages. By translating, the general capacitance for the entire line is around adjusted.

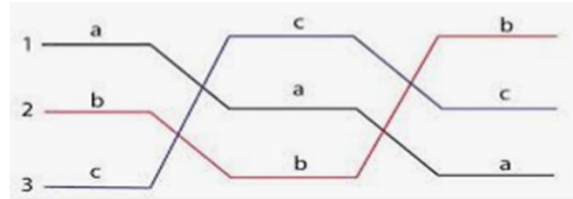


Figure 1.2: Transposition of conductors.

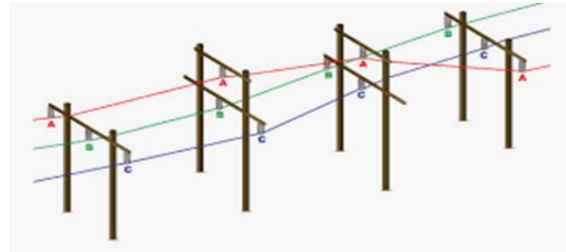


Figure 1.3: Transmission line transposition.

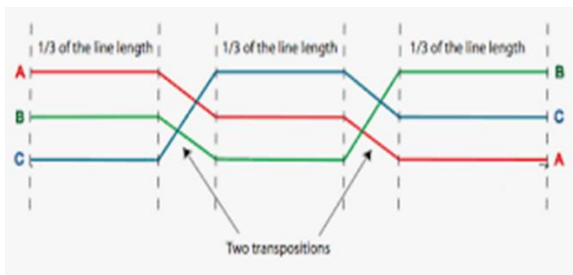


Figure 1.4: Transposition of conductors.

II. LITERATURE REVIEW

2.1 Extent of Past Works

Isaac and Ademola (2014) focused on the extremely lengthy transmission lines and that the Nigerian 330kV transmission network is characterized by high power misfortunes, Power misfortunes bring about lower influence accessibility to the buyers, prompting insufficient influence to work their apparatuses. Expanded power request pushes the power transmission organization to its maximum cut off points and then some, subsequent to shortening of the life expectancy of the organization or complete. It was challenged with such problems before the unbundling of Nigeria's current power organization, which had 11,000km of transmission lines (330kV) countless issues, for example, Inability to adequately dispatch created energy to fulfil the heap need, huge amount of unfinished transmission line tasks, power industry

support and development projects, a helpless voltage profile in the vast majority of the matrix's northern section, the current transmission lines' inability to wheel more than 4000MW of force at this time, functional issues, voltage recurrence control.

Obadote, D, J. (2009) Presentation on energy crisis in Nigeria, technical issues and solutions, in order to take care of this issues, brought about its de-fragmenting. In this manner, the Nigeria 330kV incorporated organization needs to further develop the network strength and makes a compelling interconnection. Through the Independent Power Projects, it is intended to increase transmission strength due to the high demand on the present and maturing infrastructure by developing more power stations and transmission lines.

Onohaebi and Odiase (2010) Presentation on Empirical modelling of power losses as a function of line loadings and length in the Nigerian 330kv transmission lines, In Nigeria, the major power interconnection was a 132kV line completed between Lagos and Ibadan in 1962, By 1968, the Kanji hydroelectric station had been built, providing electricity through a 330kilovolt(kV), critical outspread line transmission network to the three 132kV sub frameworks that existed at the time in the Western, Northern, and Eastern parts of the country. Initially, the 330kV and 132kV frameworks were managed separately by the Nigerian Dams Authority (NDA) and the Electricity Corporation of Nigeria (ECN). The Kainji power supply control room provided focal control for the 330kV organization. The 132kV organization was managed by a load dispatcher based in Lagos' Ijora power supply. In 1972, these two bodies were merged into a single power utility known as National Electric Power Authority (NEPA), accordingly introducing brought together guideline and coordination of the whole quickly developing 330kV and 132kV National organization. By and by, the spiral transmission network (330kV and 132kV) is supervised by the Transmission Company of Nigeria (TCN), which is responsible for the framework activity as well as market settlement capacity.

Gashimov et al (2019) explored the transmission line rendering of The EMTP(Electromagnetic Transients

Program) holds a 400kV transmission line with and without transposition, to be specific the fundamental steady boundary model from Bergeron's hypothesis. The outcomes acquired vouch for the continuation of examinations along these lines and furthermore can be utilized for taking care of the issues of arrangement of suitable unbalance level in longer queues.

Berzan et al (2018) explored the Electrical Line Mathematical Model with Phase Circuit Transposition. The goal of the paper was to improve the numerical model and technique for estimating the highly long-lasting system in a line with many conductors and rendered stages. The numerical model analyses how the electric lines will be lines with conveyed boundaries and is dependent on the message conditions. As a subject of the review it is chosen the 110 kV overhead electrical cable with two smaller circuits with the transmitters set on a level plane and circularly rendered. The underlying and limit for the case of a two-circuit electric line and the modification of the staging point of the voltages at the line input, conditions are developed. In the interpretation the upsides of the conductor boundaries change by jump, which confuses the method involved with ascertaining the working mode. The created model and expounded programming incorporate this multitude of elements. In light of the created model, computations of the working method of the two-circuit electric built, as well as a self-repaid line. For the circumstances without and with the interpretation of the stage conductors, mathematical arrangements have been obtained in regards to the development of dynamic and receptive power in the periods of the line in its various segments under guideline and no guideline of the stage shift plot. The model's utility in focusing on power transfer mechanisms in multi-conductor electrical cables has been demonstrated. The mathematical arrangements were obtained that were useful for determining the level of shared impact of stages on the capacity to move and stack under the interpretation of conductors.

III. MATERIALS & METHODS

3.1 Materials and Line Conductor Xteristics

TYP	DIAMETE	RESISITANCE
E	R(∩M)	(Ω/KM)

Phase conductors	Cardinal	29.35	0.0486
Shield wire	7N8 18M	8.78	1.3621
Tower Series	1:1 Versi		
Transformer	7.0		
ETAP			

3.2 Methods

The model relies on the wave approach developed by Bergeron and utilized by (EMTP). The losses dispersed LC line in this model is defined the surge impedance $Z_L C c = /$ and the phasing velocity $=1/ LC$ (for a single-phase line) are determined by two parameters. The method can be used to see if the treatment is appropriate for the patient study's normal hobos. More so, a simulation tool, Mat lab was used, this software is basic for the students of the electrical engineering career, in the different processes of study and knowledge in the generation, transmission, and distribution of energy. A bibliographic search was carried out on the use of this instrument in teaching processes in higher education. The pi model was used in a single-line model, applying 3 unlinear lines to build the three-phase system and simulate the respective transpositions; then the phase voltages are checked at effective values at the final end. In (Torrez & León, 2002), the highest difference seen between magnitude of the voltages and the norm of the line voltages is split by the median of the grid voltage to get the imbalance value., where the subscripts i and j correspond to phases A, B, and C. In the IEC standard (Caraballo & Bermudez, 2012), limits are recommended for the stress unbalance ratio defined by equation (3.1) of

$$U = 100 \cdot \max\left(\frac{U_{ij} - V_{pro}}{V_{pro}}\right) \tag{3.1}$$

Where U=Online voltage
Vpro=Average voltage in line

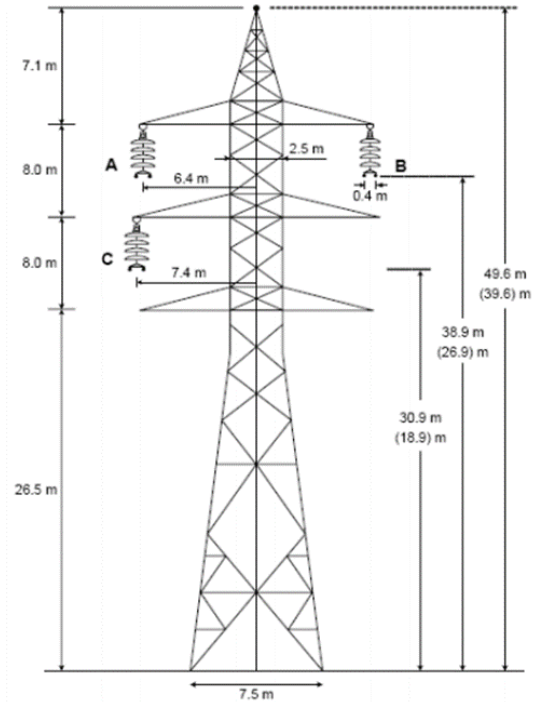


Fig 3.2 Phase configuration of transmission line and tower size

3.3 Formulation of Power Flow Equations

Formulation of Power Flow Equations

3.4 Self-Admittance

$$Y_{11} = Y_{12} + Y_{14} + Y_{16} \tag{3.2}$$

$$Y_{22} = Y_{21} \tag{3.3}$$

$$Y_{33} = Y_{34} + Y_{35}$$

$$Y_{44} = Y_{41} + Y_{43}$$

$$Y_{55} = Y_{53}$$

$$Y_{66} = Y_{61}$$

3.4.1 Mutual Admittance

$$Y_{12} = Y_{21} = -Y_{12}$$

$$Y_{14} = Y_{41} = -Y_{14}$$

$$Y_{16} = Y_{61} = -Y_{16} \tag{3.4}$$

$$Y_{34} = Y_{43} = -Y_{34}$$

$$Y_{35} = Y_{53} = -Y_{35}$$

3.4.2 Admittance matrix [Y_{BUS}]

$$\begin{bmatrix} Y_{11} & Y_{12} & 0 & 0 & Y_{14} & 0 & Y_{16} \\ Y_{21} & Y_{22} & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & Y_{33} & Y_{34} & Y_{35} & 0 & 0 \\ 0 & 0 & & & & & \end{bmatrix}$$

(3.5)

$$[I] = [Y_{BUS}] [V]$$

(3.6)

$$\begin{bmatrix} Y_{11} & Y_{12} & 0 & 0 & Y_{15} & 0 & Y_{17} \\ Y_{21} & Y_{22} & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & Y_{33} & Y_{34} & Y_{35} & 0 & 0 \\ 0 & 0 & & & & & \end{bmatrix}$$

(3.7)

$$I_i = Y_{i1}V_1 + Y_{i2}V_2 + Y_{i3}V_3 + \dots + Y_{in}V_n$$

(3.8)

$$I_i = \sum_{k=1}^n Y_{ik}V_k$$

(3.9)

$$S_i = P_i + jQ_i = V_i I_i^*$$

(3.10)

$$S_i^* = P_i - jQ_i = V_i^* I_i$$

(3.11)

Substituting I_i from (3.9) into (3.11)

$$P_i - jQ_i = V_i^* \left(\sum_{k=1}^n Y_{ik}V_k \right)$$

(3.12)

Let $V_i^* = V_i \angle -\delta_i$, $V_k = V_k \angle \delta_k$ and

$$Y_{ik} = Y_{ik} \angle \theta_{ik}$$

(3.13)

$$P_i - jQ_i = V_i^* \sum_{k=1}^n Y_{ik}V_k \angle \delta_k + \theta_{ik} - \delta_i$$

(3.14)

$$P_i - jQ_i = \sum_{k=1}^n |Y_{ik}| |V_i| |V_k| [\cos(\theta_{ik} + \delta_k - \delta_i) + j \sin(\theta_{ik} + \delta_k - \delta_i)]$$

(3.15)

Separating the real and imaginary part

Real power

$$P_i = \sum_{k=1}^n |Y_{ik}V_iV_k| \cos(\theta_{ik} + \delta_k - \delta_i)$$

(3.16)

Reactive power

$$Q_i = -\sum_{k=1}^n |Y_{ik}V_iV_k| \sin(\theta_{ik} + \delta_k - \delta_i)$$

(3.17)

3.4.3 Gauss-Seidel Method for Power Flow Solution
The G-S method for power flow solution can be derived from the expression of the complex power injected into the *ith* bus (3.8).

$$S_i = P_i + jQ_i = V_i I_i^*$$

$$I_i = \frac{P_i - jQ_i}{V_i^*}$$

(3.16)

The current entering the *ith* bus is given by

$$I_i = Y_{i1}V_1 + \sum_{k=1}^n Y_{ik}V_k$$

(3.17)

Equating (3.16) and (3.17)

$$\frac{P_i - jQ_i}{V_i^*} = Y_{i1}V_1 + \sum_{k=1}^n Y_{ik}V_k$$

(3.18)

$$Y_{i1}V_1 = \frac{P_i - jQ_i}{V_i^*} - \sum_{k=1}^n Y_{ik}V_k$$

(3.19)

For load buses,

$$V_i = \frac{1}{Y_{ii}} \left[\frac{P_i - jQ_i}{V_i^*} - \sum_{\substack{k=1 \\ k \neq i}}^n Y_{ik}V_k \right]$$

(3.20)

For voltage control bus,

$$Q_i^{(k+1)} = -\text{Im} \left[V_i^{*(k)} \left(V_i^{(k)} Y_{ii} + \sum_{\substack{k=1 \\ k \neq i}}^n Y_{ik}V_k^{(k)} \right) \right]$$

(3.21)

Where;

V_i represents the voltage on the bus i , P_i denotes the real power injected into bus i , Q_i the reactive power injected into bus i , Y_{ii} the diagonal element of the

Y-bus matrix, Y_{ik} the off-diagonal aspect of the Y-bus composite, and V_k the wattage at bus n.

3.5 Acceleration of Convergence

The Gauss-Seidel approach of power flow problem demands an excessive number of cycles before the voltage falls within an acceptable accuracy index. The use of acceleration factors can drastically reduce the number of iterations required. The difference between the new computed voltage and the best previous voltage at the bus is multiplied by the appropriate acceleration factor to provide a better correction to be added to the prior value. (3.22)

What is the location of the accelerated voltage, the acceleration factor, and the acceleration factor? In general, a power flow acceleration factor of 1.6 is considered a decent figure analysis. The incorrect choice of may cause the technique to diverge or impede convergence.

3.6 Transmission Line Calculation

3.6.1 Resistance per kilometer R_0

$$R/L = \frac{1000 \times \ell}{A} \Omega/km \quad (3.24)$$

Where;

ℓ is the resistivity of Aluminum = $2.65 \times 10^{-8} \Omega m$

A = Area of conductor = $200mm^2$

3.6.2 Reactance per kilometer X_0

$$X_0 = 0.1445 \ln\left(\frac{GMD}{r}\right) + 0.0157 \Omega/km \quad (3.25)$$

(3.25)

$$GMD = \sqrt[3]{D_{ab} \times D_{ac} \times D_{bc}} = 1.26D \quad (3.26)$$

(3.26)

$$r = \sqrt{\frac{A}{\pi}} \quad (3.27)$$

(3.27)

Where;

GMD is the geometric mean distance of conductor

r is the radius of conductor

D is the distance between adjacent conductor (D=2m).

$$\pi \text{ is a constant} = \frac{22}{7} = 3.142$$

3.7 Distribution System Load Calculation

$$\text{Average Current } I_L = \frac{I_R + I_Y + I_B + I_N}{3} \quad (3.28)$$

$$\text{Secondary Current } I_S = \frac{P_{(KVA)}}{0.7188} \quad (3.29)$$

$$\% \text{ Loading of Transformer} = \frac{\text{Average Current}}{\text{Secondary Current}} \times 100 \quad (3.30)$$

$$\text{Measured Load} = \% \text{ Loading} \times \text{Transformer Rating} \quad (3.31)$$

$$\% \text{ Average Loading} = \frac{\text{Sum of \% Loading of Transformers}}{\text{Total number of Transformers}} \quad 3.32$$

Where;

I_R is the measured current on the red phase, I_Y is the measured current on the yellow phase, I_B is the measured current on the blue phase, I_N is the measured current on the neutral.

3.8 Simulation of the Network

The information for the power/load stream examination incorporates; PV framework yield power, greatest and least receptive power breaking point, MW and MVAR top burdens, Impedance of the lines, transmission line sizes, voltage and power appraisals of the lines and transformer information, and the ostensible and basic voltages of every one of the transports. The organization was displayed and reproduced in ETAP 7.0 Electrical Transient Analyser Program utilizing G-S power stream calculation to decide the dynamic and responsive power streams in all branches in the organization, dynamic and receptive power misfortunes in every part in the organization, transport voltages extents and points all through the organization.

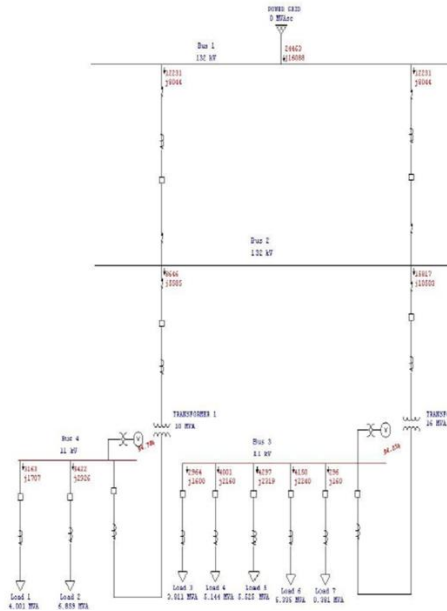


Figure 3.3: Load flow diagram of 132kv Network

IV. RESULTS AND DISCUSSIONS

In the Previous section, the methodology to make the dynamics simulations is presented. However, in order to analyse and study analysis of effects of conductor transposition on the 132kv Alaoji-port Harcourt transmission lines, different line parameters had to be simulated: There results are as shown below:

3.9 Simulation System

The whole model the case study is built in the Simulink environment (MATLAB), and ETAP version 12.6 is used to simulate it.

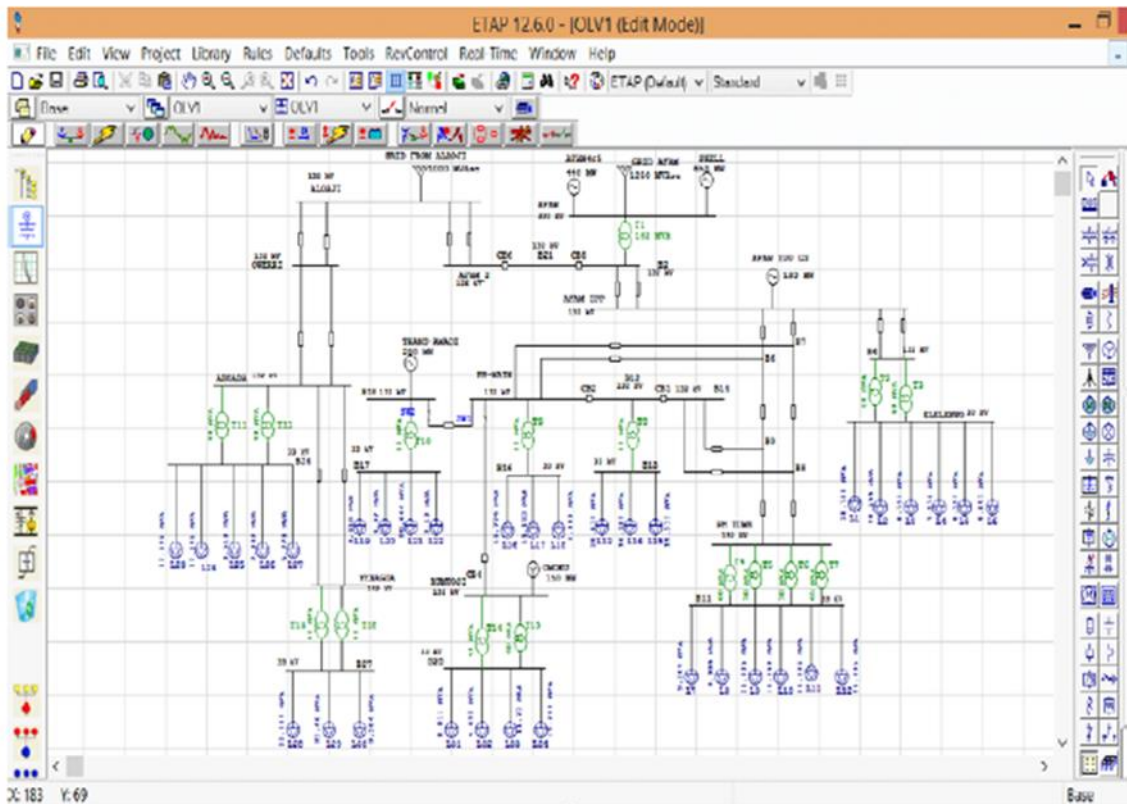


Figure 3.4: The Base-case Network of the Alaoji-Port Harcourt 132 KV transmission Lines

4.1 Parameters used in the Analysis

Table 3.9 Simulation parameters used

Serial No.	Quantity	Value
1	Supply Voltage	415V, 50Hz (line-line)
2	Tower height	18M
3	AC lighting source	10KA
4.	CFO	650KV
4	Source Impedance	$R_s = 0.5 \Omega$, $L_s = 0.1 \text{ mH}$
5	DC Capacitor	5000 Uf
6	DC Link Voltage	680V
7	Ripple filter	$L_f = 2 \text{ mH}$, $C_f = 50 \text{ uF}$
8	Series Transformer	1:1
9	Switching Frequency	20 kHz
10	Load	Three Phase Balanced Linear Load $R - L \text{ load } (R = 30 \Omega, L = 0.302 \text{ H})$

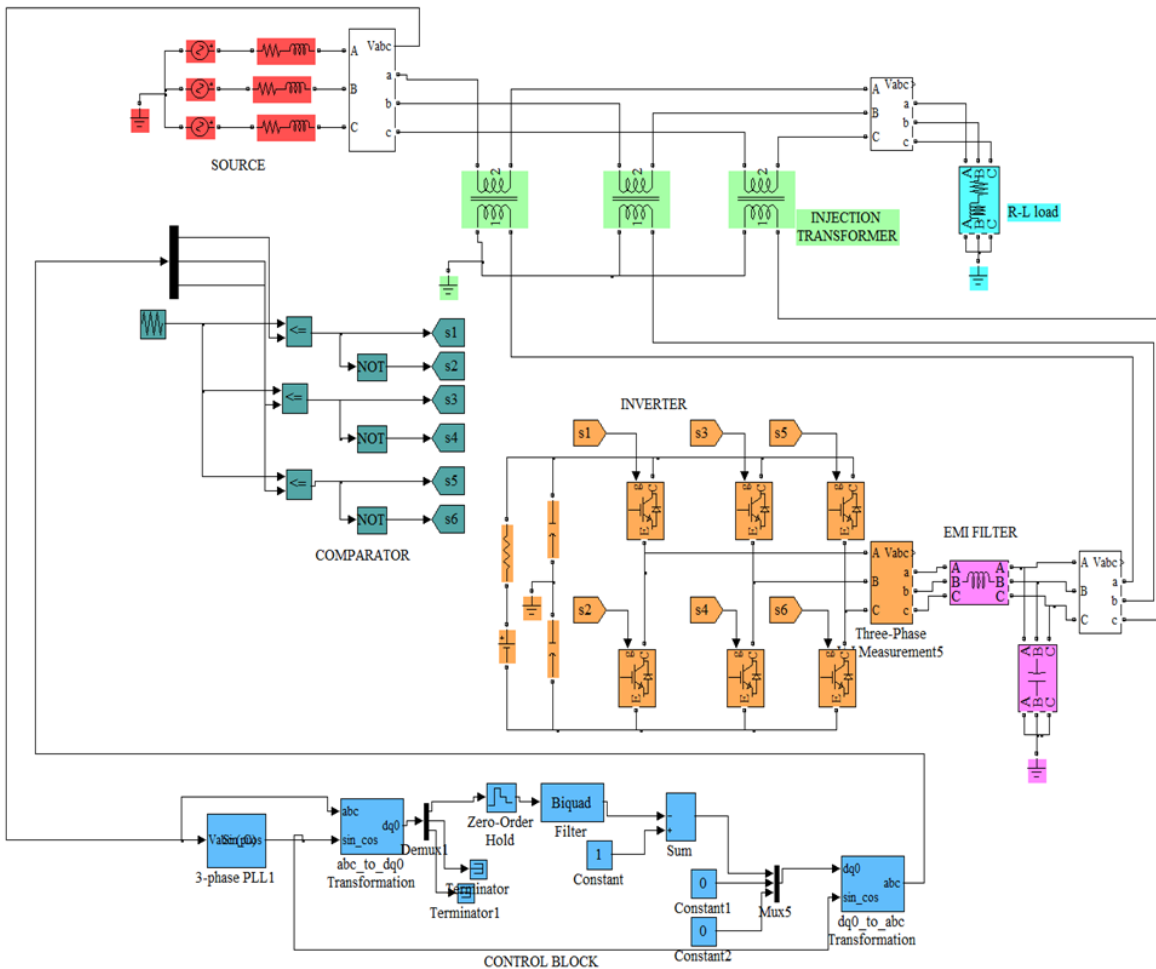


Figure 3.5: Circuit Diagram of MATLAB Simulation

The above figure shows an inclusive model of DVR designed in the Simulink environment (MATLAB). The model is made up of a control block, comparator, electromagnetic interference (EMI) filter, Injection transformer, Inverter, Load, and Source. The source is generate as a result of different supply voltage instability. The inverter is a device that converts DC power into AC power. The primary voltage, as well as the voltages of switching frequencies and multiples of switching frequencies, are included in the inverter's output. Thus, EMI filters are eliminated by using switch frequency voltages and multiples of switching frequency voltages. The comparators by contrast the sinusoidal signal with a triangular signal are generate by pulses. The injection transformer distributes the inverter's AC voltage to each phase of the line. The reference signals to the Pulse width modulation (PWM) inverter are generated by the control block.

4.2 Supply Voltages

4.2.1 Case I: Balanced Supply Voltage

For various supply voltage disruptions, the power across the load is kept stable. The injected electrical energy by the power source converter is zero ideally once the rated impartial voltage is applied to the freight, however it supplies a very low voltage to compensate for the drop in the vaccination transformer.

The balanced source voltage is represented by the following equations.

$$v_{sa} = 338.846 \sin (wt) \tag{4.1}$$

$$v_{sb} = 338.846 \sin (wt) \tag{4.2}$$

$$v_{sc} = 338.846 \sin (wt) \tag{4.3}$$

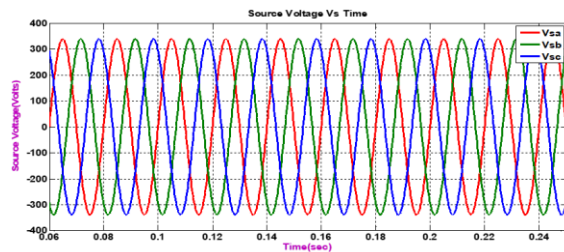


Figure 3.6: Source Voltage for Balanced Supply Voltage

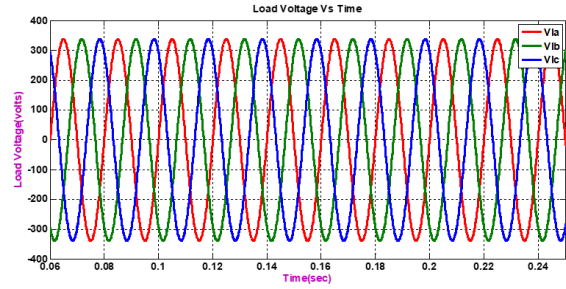


Figure 3.7: Load Voltage for Balanced Supply Voltage

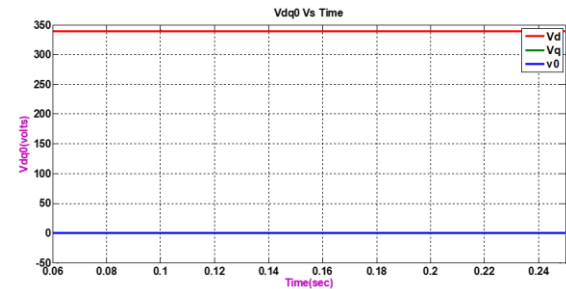
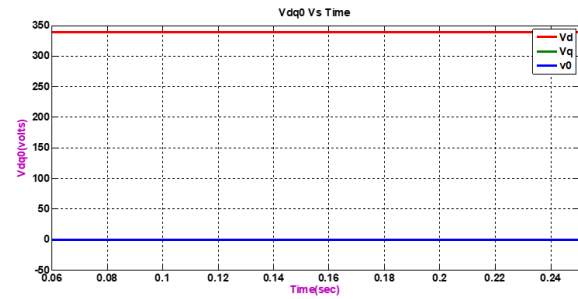


Figure 3.8: (a), (b) Direct, Quadrature, and Zero axis voltages

The waveforms of direct, quadrature, and zero pole voltages under balanced supply voltage are shown in the diagram above (sim performed in Matlab Simulink). The phase and zero axis voltages are zero after transferring the dc source to a synchronously rotating reference frame (abcto dq0). Figure 4.7 depicts the pattern of the Balance Sag Source Voltage. (Matlab Simulink is used for simulation). Between 0.08 and 0.2 seconds, the voltage sag is provided (6 cycles). The Load Pulses are depicted in Figure 4.8. (Simulation is done in Matlab Simulink). From 0.08 to 0.2 seconds, DVR injects electricity. The voltage out across the load is kept constant, as shown in the waveform.

4.2.2 Case II: Balanced Supply Voltage (Sag)

The balanced sag voltage with 20% sag is shown in the calculations below. The line to transmission line voltage is 415V, while the peak phase voltage is 338.846V.

$$v_{sa} = (338.846 * 0.8) \sin(\omega t) \quad (4.4)$$

$$v_{sb} = (338.846 * 0.8) \sin(\omega t - 120) \quad (4.5)$$

$$v_{sc} = (338.846 * 0.8) \sin(\omega t - 240) \quad (4.6)$$

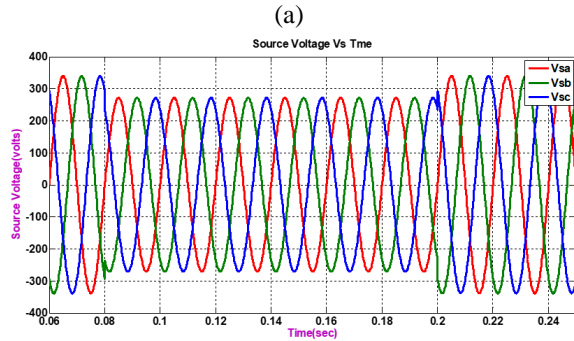


Figure 3.9: Source voltage for Balanced Supply Voltage (Sag)

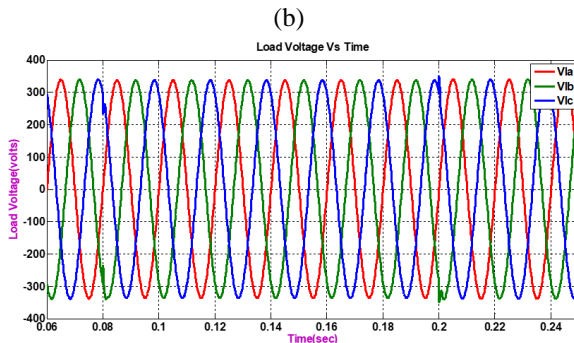


Figure 4.1: (a), (b) Load voltage for Balanced Supply Voltage (Sag)

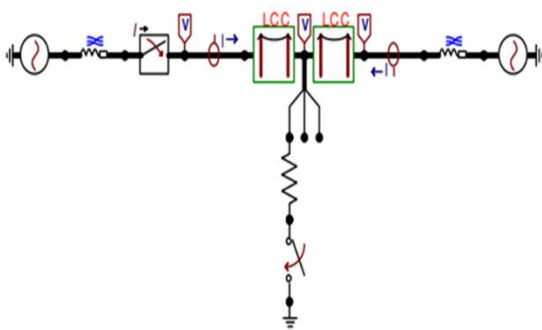


Fig.4.2 The model of untransposed line at phase closing

The client specifies a three-stage line/link model when adding a line or link to the circuit. The client identifies whether the portion is a connection or an overhead line using this powerful exchange box. The mathematical and material boundaries can then be entered in the Data section. The ground resistivity, underlying recurrence, and line/link length are all listed under Standard information. Finally, the client selects the suitable electrical model from the Model drop-down menu, as well as the exceptional recurrence and fitting information required for each case. It's simple to move between the many electrical models (PI, Bergeron, JMarti, Semlyen, and Noda), and ATP Draw takes care of everything except the unique pi-areas. Only those cases are upheld that actually establish an electrical model. A Bergeron example of a 132kV overhead line is depicted in Fig. 3.1. The model is based on the Electromagnetic Transient Program's Bergeron voyaging wave approach (EMTP). The flood impedance and the misfortunes circulating LC line are represented in this model (for a one stage line).

$$Z_C = \sqrt{L/C} \quad (4.7)$$

Furthermore, the stage speed

$$V = 1/\sqrt{LC} \quad (4.8)$$

The technique can be utilized to check if the model is reasonable for the ordinary drifters happening in the review.

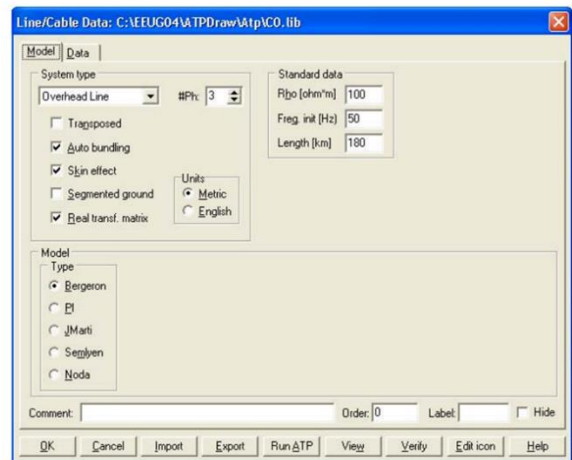


Fig 4.7: Model data, standard data (grounding and frequency), and system type (line or cable) (Type of model and frequency)

Ph.no	Rin	Rout	Rresis	Hoiz	Vlower	Vmid	Separ	Alpha	NB
#	[cm]	[cm]	[ohm/km DC]	[m]	[m]	[m]	[cm]	[deg]	
1	0.3505	1.517	0.0586	-7.4	30.9	18.9	40	0	2
2	0.3505	1.517	0.0586	0	30.9	18.9	40	0	2
3	0.3505	1.517	0.0586	7.4	30.9	18.9	40	0	2
4	0.2445	0.489	1.4625	0	49.6	39.6	0	0	0

Fig.4.4: Specification of conductor data

Compute marks of power and existing in a ground mistake is the untransposed line at stage C. obtainable on Figure 4.12.

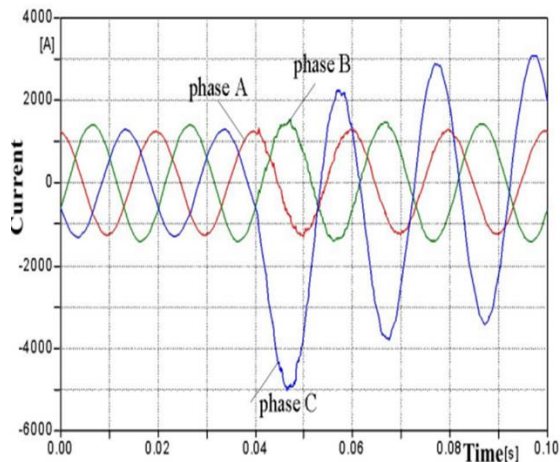


Fig.4.5: Current value of phase of untransposed line

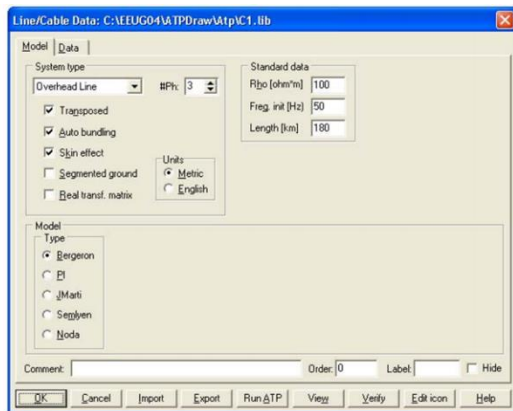


Fig.4.6: Line/Cable dialog box with Transposed

The earth error is exposed on the compute results of voltage and present of transposed broadcast column at phase C.

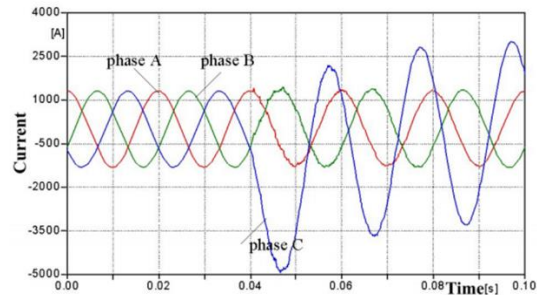


Fig 4.7: Current value at phase of transposed lines

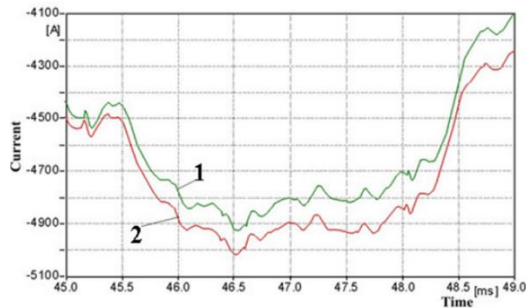


Fig. 4.8: With and without transposition, the current value at phase C is: 2- without transposition; 1- with transposition; 2- without transposition

The process fault of the B and C phases, often with permutation, has also been examined. Figure 4.16 depicts the model of a sensation line following such process fault of the B and C periods in ATP-EMTP.

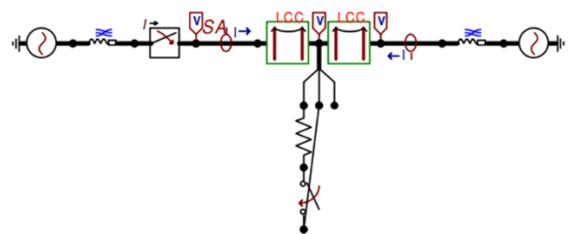


Fig.4.9: During the phase-to-phase fault of the B and C phases in ATP-EMTP, the model of an untransposed line is used.

Figure 4.18 shows the calculate results of the present throughout the phase-to-phase error of B and C phases without transposition.

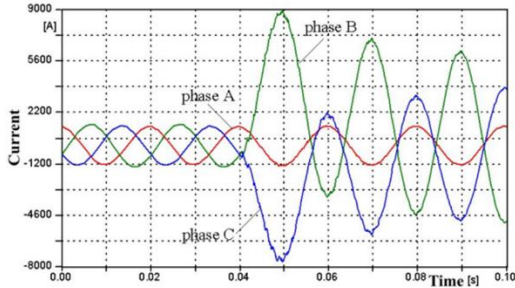


Fig.4.10. Current value without transposition during phase-to-phase fault

4.3 Discussion of Findings

This simulation was performed first with a distance of 180 kilometres, with 3 segments of 60 kilometres each; without transposition and then with transposition.

Extreme receiver results: No transposition as shown in table 4.1

Table 4.1: Results of the tensions without transposition

Simple voltage of each phase	Value in kV.
V1n	126.30
V2n	127.22
V3n	128.32

Results at the receiver end: with transposition, it is observed in table 4.2

Table 4.2: Results of transposition voltages

Simple voltage of each phase	Value in kV.
V1n	127.27
V2n	127.25
V3n	127.32

As observed in the voltage values, in both models, the results with transposition differ very little, but without transposition the unbalance value obtained is 0.8%.

Long

This simulation was done with a distance of 300 kilometres, with 3 segments of 100 kilometres each. Results in extreme receiver: without transposition experienced in table 4.3

Table 4.3: Results of the voltages without transposition

Simple voltage of each phase	Value in kV.
V1n	125.74
V2n	127.28
V3n	129.18

Table 4.4: Results of transposition voltages

Simple voltage of each phase	Value in kV.
V1n	127.38
V2n	127.33
V3n	127.47

The unbalance obtained in this case without transposition is 1.39%. As observed in the values of tension in both long line modelling, the results with transposition differ very little, but those without transposition have a deviation of 1.39%; which exceeds the maximum allowable unbalance value. Standard IEC-61003-3-13, admits values lower than 1% of unbalance of tensions (Grainger, 2002).

Breaking down the got results, we can make reference to when the complimentary shared impact of the two stages and line circuits is considered, the cycles in multi-stage or multi-conductor electrical cables become much more complicated. So, in terms of the "autonomy" of the system during multi-conductor line periods, it is possible to speak only about the situation when these conductors are located at substantial distances from each other. Truth be told, the propensity of compaction of the electrical cables prompts the expansion in shared impact of channels and prompts the intricacy of the computation strategies should have been applied to acquire more precise outcomes.

Rendering of conductors brings about full balance Three-stage circuits are used to transmit power. Mechanically, two-circuit electric wires have two circuits rendering doesn't guarantee the adjusting of force sent through circuits with regards to the electrical line assessment as a productive component incorporated with the utilization of conventional interpretation arrangements. This is very clear when these lines are recognized as having the capability to achieve a controlled operating mode, such as by

adjusting the stage shift point in self-remunerated lines, On account of self-repaid electric electrical cables, the power transmission qualities of the different areas are more intricate contrasted with the instance of a smaller line without the use of the approaching voltage vectors' stage shift pivot innovation. The divergence between the transmitted powers in the associated load mode is estimated to be around 7–8% due to a two-circuit line without conductor interpretation. At the stage shift point change, the power infusion attributes in the multi-circuit line and the absorption of this power by the line's heap change as well.

CONCLUSION

Separating the gotten results, we can make reference to when the integral common impact of the two phases and line circuits is considered, the cycles in multi-stage or multi-conduit electrical links become substantially more complex. So, when it comes to the "independence" of the framework in the case of a multi-conductor line, it's best to focus on the situation when the conductors are separated by large distances. To be honest, there is a tendency for the soil to compact electrical links prompts the development in shared effect of channels and prompts the multifaceted design of the calculation methodologies ought to have been applied to get more exact results.

Delivering of conductors achieves transmission of full-equilibrium power through three-phase circuits. The mechanical supplying of power sent through circuits in two-circuit electric lines does not secure the changing of power sent through circuits as a helpful part of the electrical line appraisal as a useful part combined with the employment of traditional understanding courses of action. This is especially true when these lines are identified as having the ability to achieve the regulated functioning mode, such as by modifying the stage shift point in self-compensated lines. The power transmission characteristics of diverse regions are more complicated as a result of self-reimbursed electric electrical links, as evidenced by the occurrence of a more modest line without the use of the stage shift turn development of the moving toward voltage vectors. The difference between the imparted powers in the corresponding burden mode is estimated to be around 7–8% due to a two-circuit line

without conductor understanding. It can also be noted that when the stage shift point changes, the power implantation ascribes in the multi-circuit line and the osmosis of this power by the pile of the line fluctuate.

RECOMMENDATIONS

Based on the study's findings, the following suggestions were made:

- i. It is possible that, in order to get a satisfying outcome while balancing power flows via phases and circuits of multi-conductor lines, various copper replacement methods will need to be investigated in order to achieve a higher degree of line equilibrium.
- ii. It can be shown that the proposed calculation technique is reliable when examining the specifics of the performance of cross electric lines with copper permutation, such as the circumstance of regulating transmission line capacity by adjusting the phase shift angle of the input power.

ACKNOWLEDMENT

My profound gratitude goes to God for His Love, mercy and grace throughout my years of study.

My unquantifiable gratitude goes to my great and most friendly supervisors, Prof. D. C. Idoniboyeobu, Engr. Dr. S. L. Braide, for their untimely assistance and directions from the starting point to the zenith of the study, I appreciate every academic guidance from you.

I am highly indebted to all my lecturers and Staff of the Department of Electrical Electronics Engineering and to my colleagues for all the support.

Finally my appreciation goes to my parents Chief Mr & Mrs Vincent Awuje ,My siblings Mrs Evidence Dennis, Mrs Chigala Ideozu, Vincovin Awuje, Kwame Awuje,Oluchi Awuje, My Course mates turned friends Mr Uzoma Okogbule, Supreme Onu, Mr Divine, Miss Agbor Blessing, My beloved friends Miss Precious Ahiakwo, Miss Henry Ada beauty, Franklin Socrates, Madighi Ezikwas, Isaac Iruene, Warighaye Diepriye, Famous Aimihiefe, Gwushim Uchibeke, I say a very big thank you for your relentless effort, advise and support towards my career.

REFERENCES

- [1] Aboshosha, H. & El Damatty, A. (2013). Span reduction factor of transmission line conductors under downburst Winds. *J. Wind Eng., the 8th Asia Pacific Conference on wind Engineering Chennai, India*, DOI: 10.3850/978-981-07-8012-8_P11. pp. 13–22
- [2] Aboshosha, H., & El Damatty, A. (2014). Effective Technique to Analyse Transmission Line Conductors under High Intensity Winds. *Wind and Structures, Dept. of civil and environmental engineering, London, Ontario, Canada*, 18(3). DOI: 10.12989/was.2014.18.3.235. Pp.235-252
- [3] Arif, M. Babayeva, A.R, & Nayir, A. (2009). Transmission line transposition. *Electrical and Electronics Engineering international Conference*
- [4] Berzan et al (2018) Mathematical Model of Electrical line with transposition of Phase circuits, *Institute of Power Engineering, Kishinau, Republic of Moldova*, 2(37), DOI:10.5281/zenodo.1343398 p.p. 1-12
- [5] Caraballo, J. & Bermudez, O. (2012). Computational tool to monitor voltage stability in power systems using Phasor synchronized measurement technology. *University, Science and Technology*, 16(63), pp.93-103
- [6] Cedeno, M. L. D., Arteaga, M. G. D., Perez, A. V., & Arteaga, M. L. D. (2017). Regulatory framework for Renewable energy sources in Ecuador case study Province of Manabí. *International journal of Social Sciences and Humanities*, 1(2), pp.29-42. <https://doi.org/10.29332/ijssh.v1n2.33>
- [7] Cheng, D. K. (1990). *Field and wave Electromagnetics*, Addison Wesley Inc., Boston, Pp.547-557.
- [8] Colome, G. (2001). Tools for teaching electrical power systems. *Argentine journal of Engineering Education*, 2(4)
- [9] Colome, G. (2013). Integration of Contents in the Practical and Laboratory III course of the Electrical Engineering, Degree, 3(2)
- [10] Ducluzaux, A. (2002). Extra losses caused in high current conductors by skin and proximity effects, Schneider Electric, Tech. Rep. Cahier Technique no. 83.
- [11] Grainger, J. J., Stevenson, W. D., & Stevenson, W. D. (2003). *Power System Analysis*, ISBN: 12938 978-00706
- [12] Guirado, R. Asensi. R., Jurad. F., & Carpio, J. (2006). *Electrical Technology*, ISBN: 84-841-4807-X Pages, Spain, McGraw hill, pp.102-112.
- [13] Hadi, Saadat. (2004). *Power System Analysis*, Milwaukee School of Engineering, Milwaukee, Wisconsin, McGraw Hill.
- [14] Idoniboyeobu, D. C. (2017). *Conductor Transposition, Lecture note on Power technology*. Rivers State University. Port Harcourt. Nigeria.
- [15] Jose, A. Brandao, F. & Guerreiro, M.V. (2004). Non three phase power lines, resonance effects due to conductor Transposition, *international journal of electrical power & energy systems* 26(2):103-110
- [16] Liang, T. Hudson. Hall, S. Heck, H. & Brist, G. (2006). A practical method for modelling PCB transmission Lines with conductor surface roughness and wideband dielectric properties, *in microwave Symposium Digest, 2006. IEEE MTT-S International*, 1780-1783. DOI:10.1109/MWSYM.2006.249721
- [17] Magnusson. C., Alexander. C., Tripathi, V. K. & Weisshaar, A. (2001). *Transmission lines and wave propagation*, C.R.C Press, ISBN: 9781315214801, DOI:<https://doi.org/10.1201/9781315214801>, pp.78.82.
- [18] Obadote, D, J. (2009) Energy Crisis in Nigeria: Technical issues and solutions, A Paper presented at the power Sector prayer Conference from June25-27, 2009
- [19] Pérez, H.L., Pérez, S., & Florez, J. (2010). Design of an efficient tool for automatic fault simulation in power Electrical systems. *Dyna*, rev.fac.minas [online], 2010, 77(164), pp.229-239, ISSN: 0012-7353.
- [20] Puumeto, M., Gomez, J., & Vaschetti, J. (2014). Reduction of unbalance factors in a medium voltage distribution System due to the insertion

- of distributed generation. Technological information, 25(4), 91-102
- [21] Rakov, A. & Rachidi, F. (2009). Overview of recent Progress in lightning research and lightning protection, *IEEE Transactions on Electromagnetic Compatibility*, 51(3) 428-442, DOI:10.1109/temc.2009.2019267
- [22] Rossi, A. & Baldini, P. (2008). Computational tool for the teaching of the electric field in industrial facilities. Technological Information, 19(3), 79-88
- [23] Saadat, Hadi. (2004). Second Edition, ISBN: 007-123955-3, McGraw Hill, International Edition, Singapore,
- [24] Sarvari, R. (2008). Impact of size effects and anomalous skin effect on metallic wires as GSI interconnects, Ph.D. *Dissertation, Georgia Institute of Technology*.
- [25] Smith, G. S. (1972). Proximity effect in systems of parallel conductors, *Journal of Applied Physics*, 43(5), pp. 2196-2203.
- [26] Torrez, M.J., & Leon, F.M. (2002). Voltage Unbalance due to Non-Transposed high voltage Transmission lines, IEEE
- [27] Washington, C. Miguel, F., Wilber, A., & Julio, C. (2019) Transposition of Medium and Long Transmission lines, Universidad Tecnica De Manabí, ISSN: 2550-6943, *Journal of Physical Sciences and Engineering* 3(1)
- [28] Yen, Z. & Fazarinc, Z. Richard, W. (1982). Wheeler, .Time domain skin effect model for transient Analysis of Lossy transmission lines, *Proceedings of the IEEE*, 70(7) pp.750 .757.
- [29] Yu, P, Wong, P. & Kaempffer, F. (1995). Tension of conductor under concentrated loads. *J. Appl. Mech.* Sept, 62(3), pp.802–809. doi:10.1115/1.2897017